


.1 .2 .3 .4 .5 .6 .7 .8 .9 1 2 3 4 5 6 7 8 9 10

.1 .2 .3 .4 .5 .6 .7 .8 .9 1 2 3 4 5 6 7 8 9 10

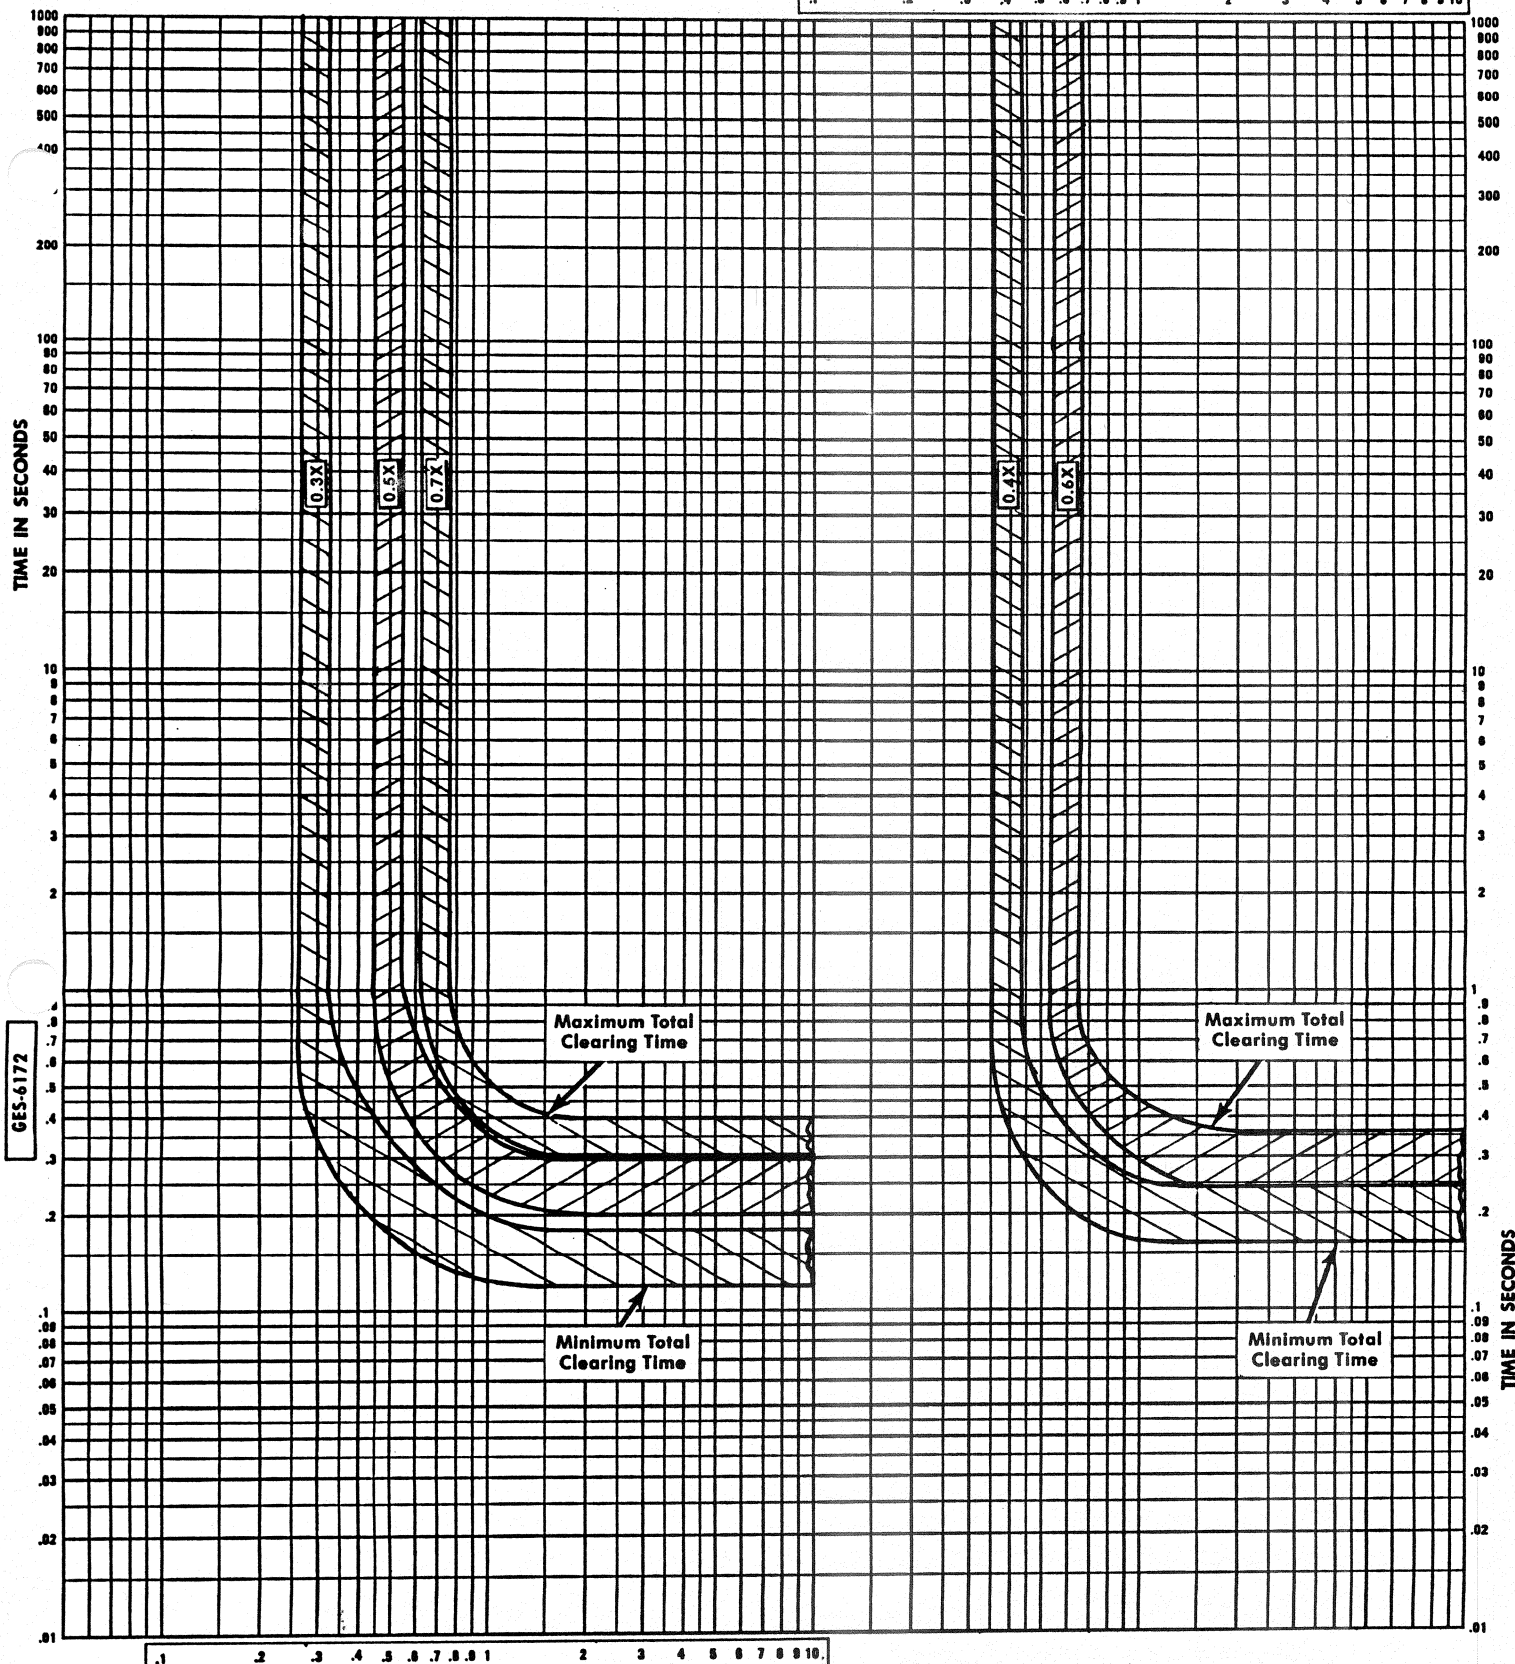

GES-6172

TIME IN SECONDS

.1 .2 .3 .4 .5 .6 .7 .8 .9 1 2 3 4 5 6 7 8 9 10

.1 .2 .3 .4 .5 .6 .7 .8 .9 1 2 3 4 5 6 7 8 9 10

### MULTIPLES OF SENSOR AMPERE RATING

**GENERAL ELECTRIC**

## INSULATED-CASE CIRCUIT BREAKER **POWER BREAK<sup>®</sup>** **With SelectTrip<sup>™</sup>**

**GES-6172**

**Sensor Rating (Amperes)**  
800, 1000, 1200, 1600 amperes

**Voltage Rating**  
600 volts ac

**Frequency Rating**  
50/60 Hertz

**Types TPR, THR, TPRR, THRR**

**Ground Fault Pickup Settings  
and Delay Time-current Curves**

(Curves apply at 50/60 Hertz and from -20C to +55C breaker ambient)

#### Adjustments

Ground Fault Unit: Pick-up current settings are 0.3x, 0.4x, 0.5x, 0.6x, and 0.7x of breaker sensor ampere rating. Time-delay bands vary with pick-up current setting as shown above.