


MULTIPLES OF AMPERE SETTING (CONTINUOUS)

Multiples of Sensor Ampere Rating

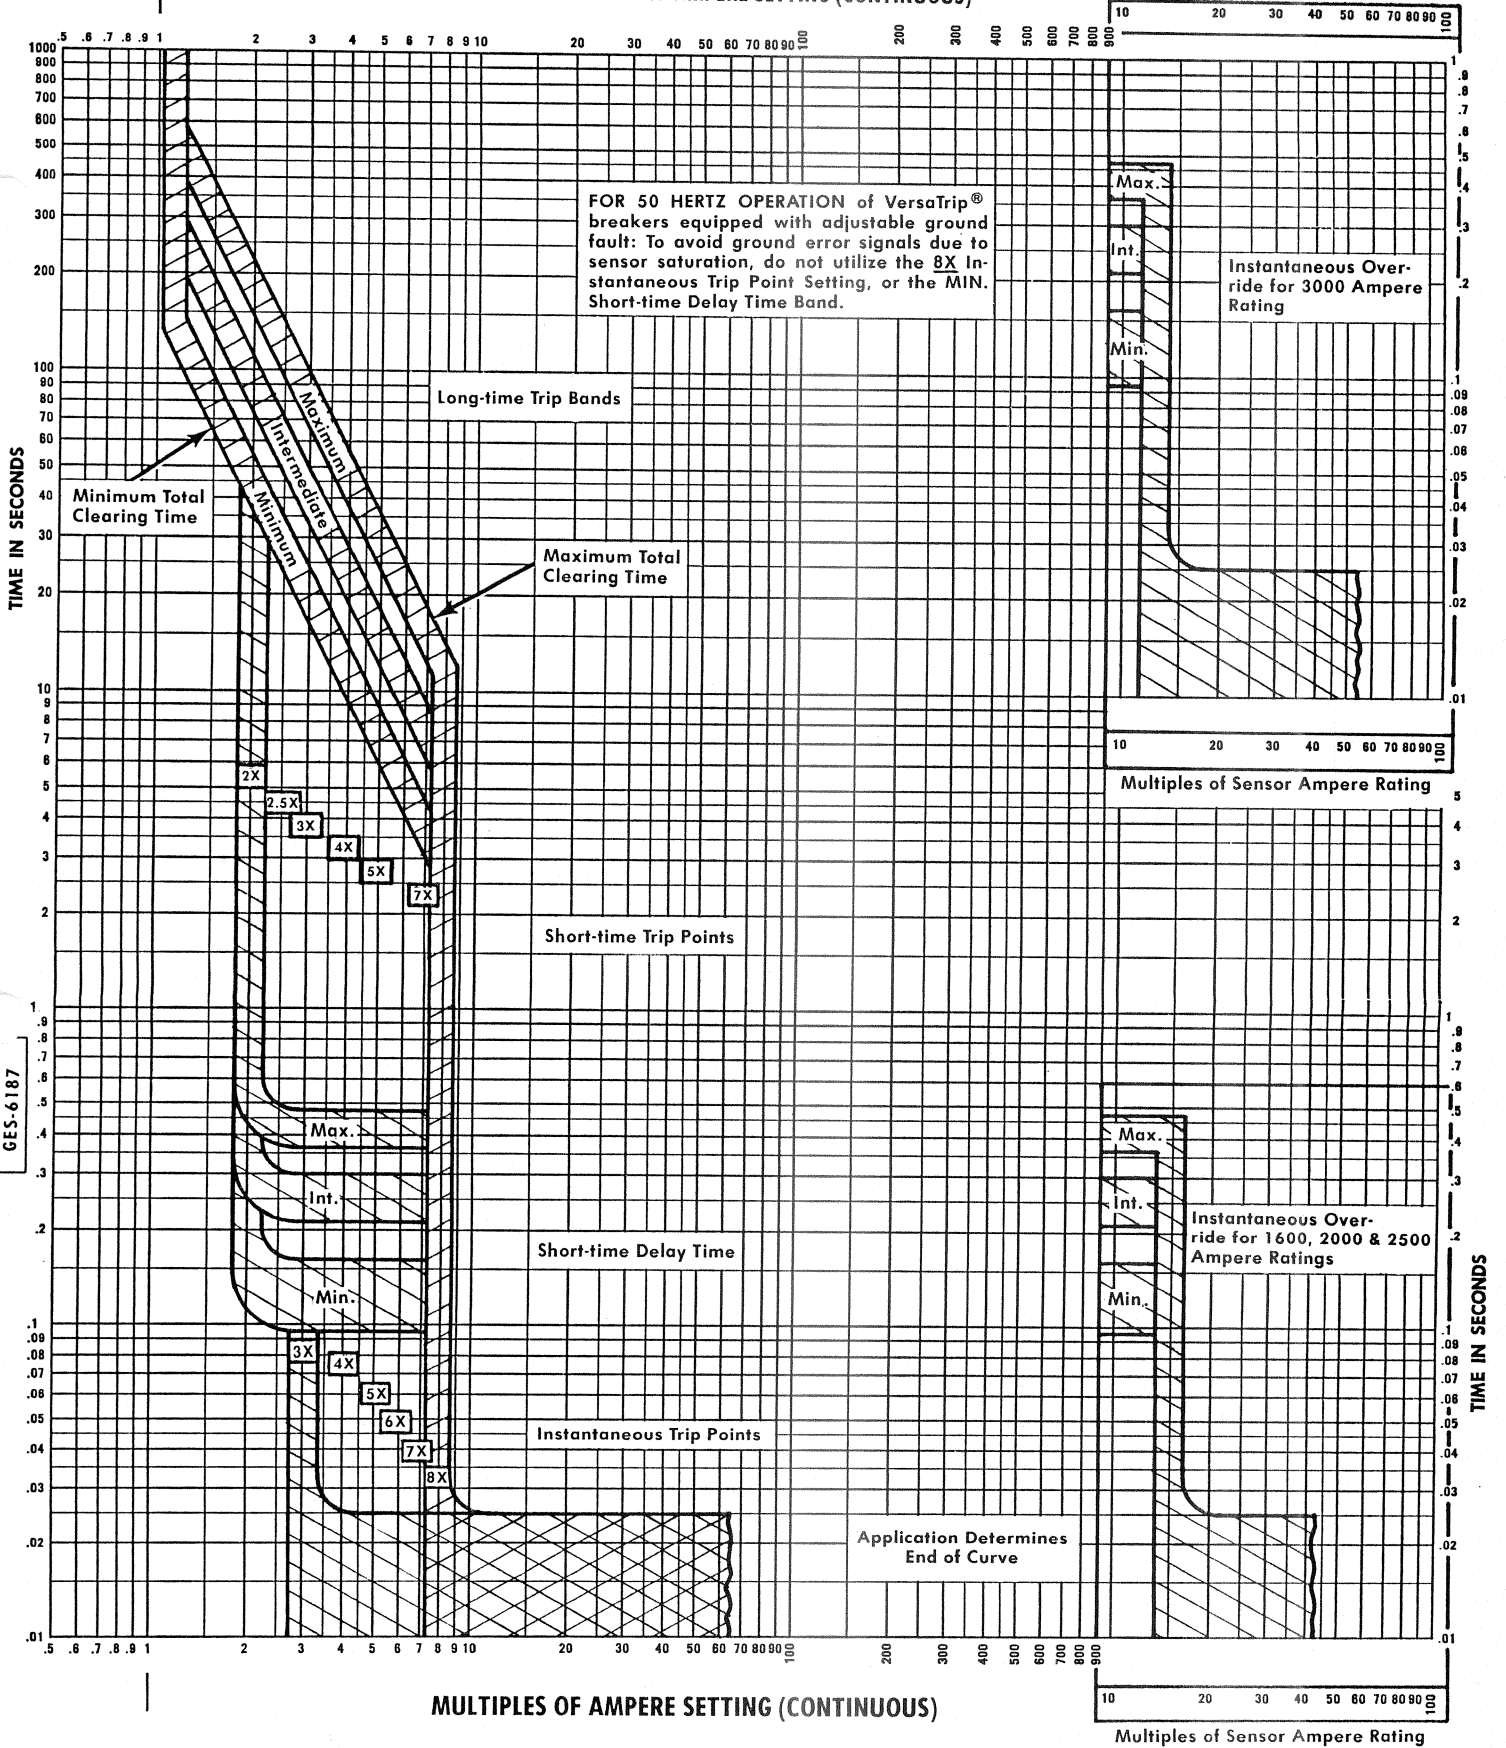

GES-6187

GENERAL ELECTRIC

Sensor Rating  
2000, 2500, 3000 amperes  
1600A frame - 1600 amperes

Voltage Rating  
600 volts ac

Frequency Rating  
50/60 Hertz

INSULATED CASE CIRCUIT BREAKER  
**POWER BREAK®**

Solid State

With **VersaTrip®**  
MOD2

Types TPSS, THSS Long-time, Short-time  
and Instantaneous Time-current Curves

(Curves apply at 50/60 Hertz and from -20C to +55C breaker ambient)

GES-6187

Adjustments

Long-time Delay Unit: Continuous current settings are 50, 60, 70, 80, 90 and 100% of sensor rating. Time-delay bands are maximum intermediate and minimum.

Short-time Delay Unit: Pick-up current settings are 2X, 2.5X, 3X, 4X, 5X and 7X multiples of long-time unit setting. Time-delay bands are maximum, intermediate and minimum.

Instantaneous Unit: Pick-up current settings are 3X, 4X, 5X, 6X, 7X and 8X multiples of long-time unit setting.

Instantaneous Over Ride: Set at 15X for 1600A, 2000A and 2500A ratings and 13X for 3000A rating of sensor ampere rating when the adjustable instantaneous unit is omitted.