


MULTIPLES OF AMPERE SETTING (CONTINUOUS)

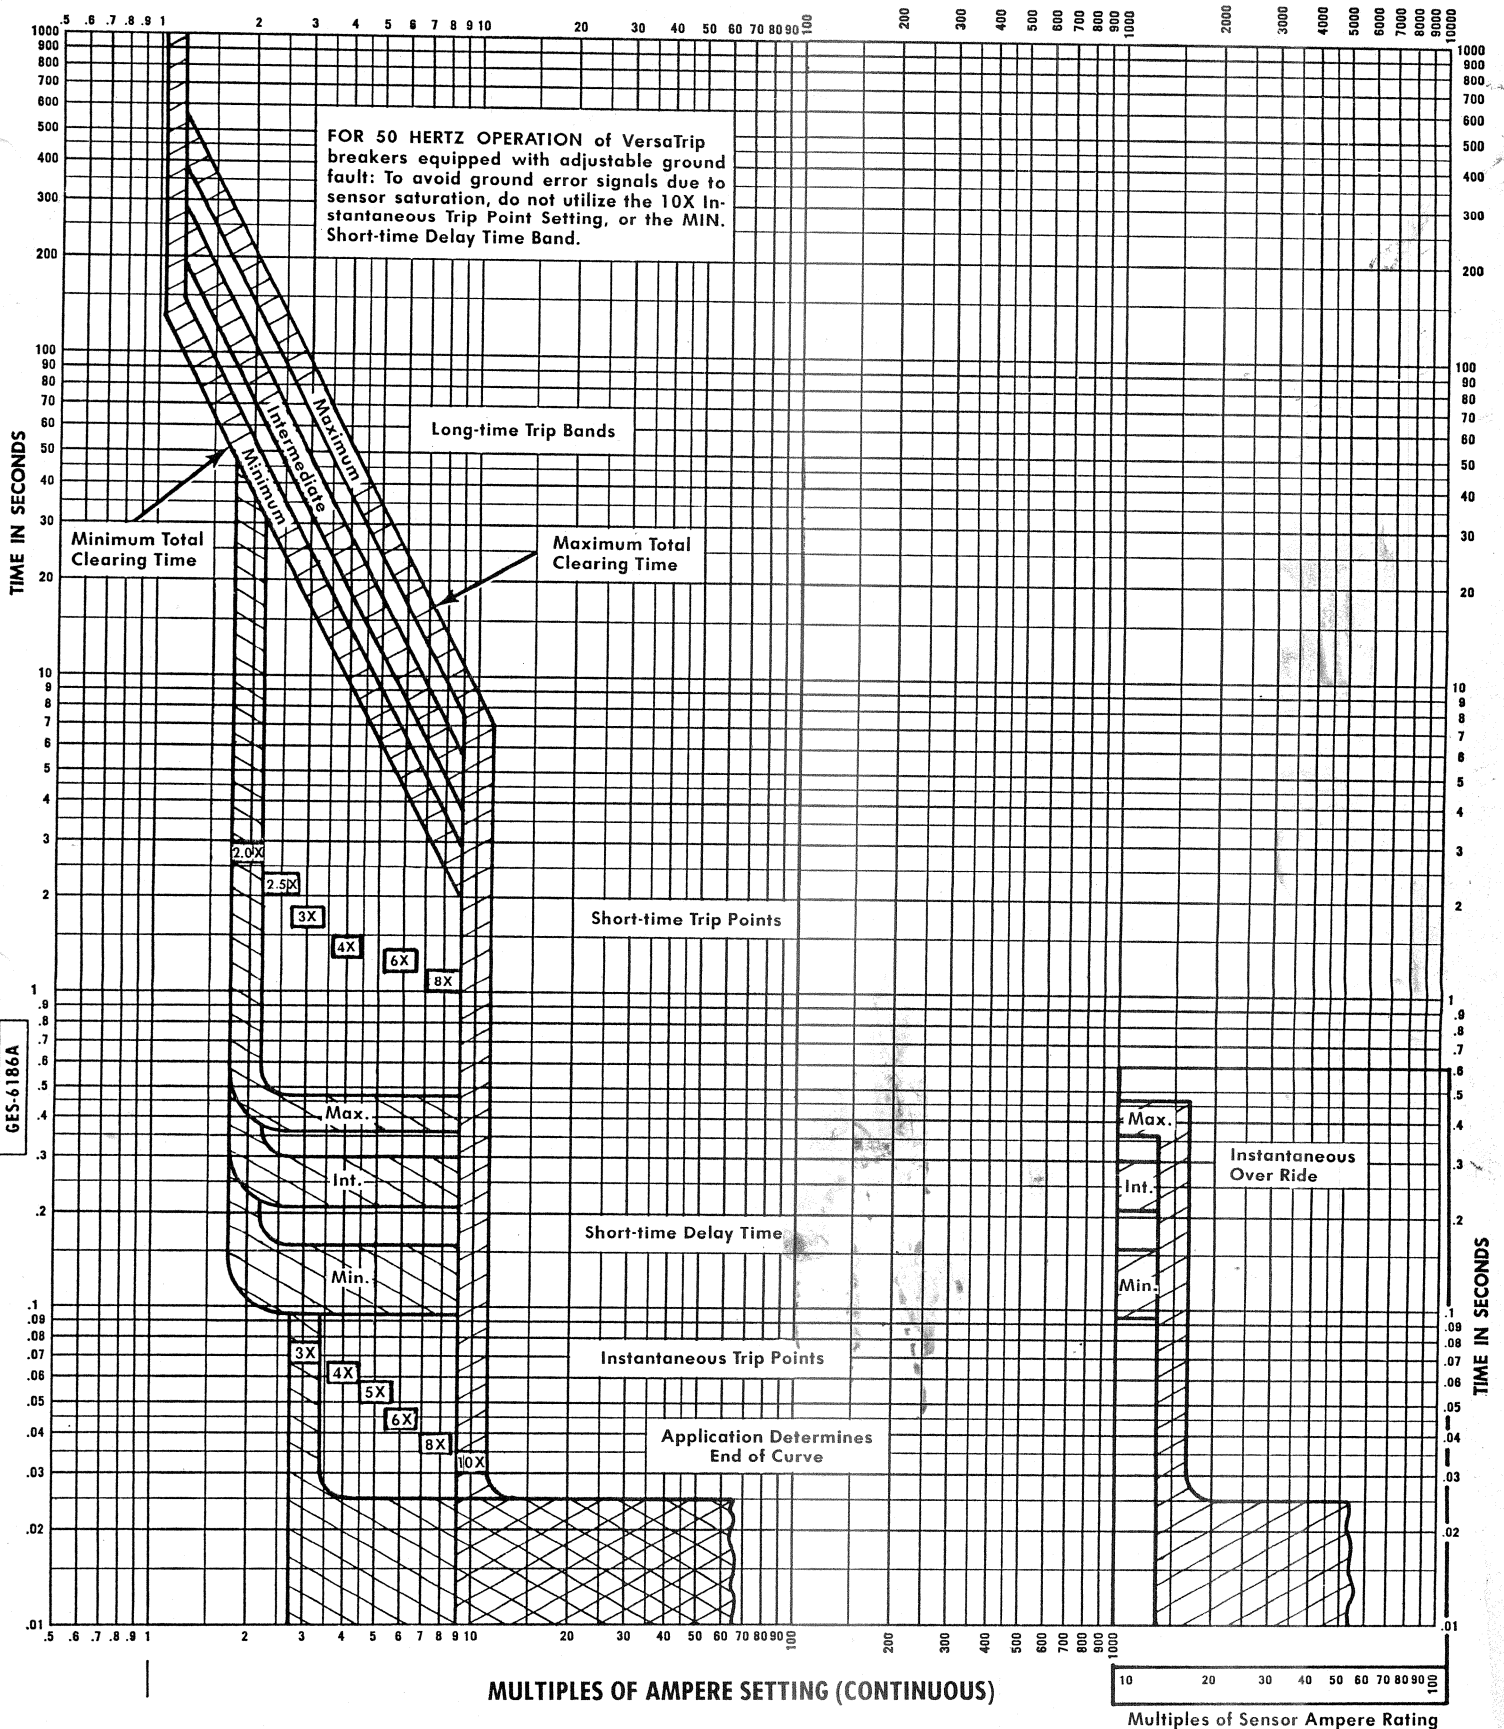

MULTIPLES OF AMPERE SETTING (CONTINUOUS)

Multiples of Sensor Ampere Rating

GENERAL ELECTRIC

Sensor Rating (Amperes)
 200, 400, 600, 800,
 1000, 1200 amperes
 2000A frame - 1600 amperes
Voltage Rating
 600 volts ac
Frequency Rating
 50/60 Hertz

**INSULATED CASE CIRCUIT BREAKER
 POWER BREAK®**

Solid State
 With **VersaTrip®**
 MOD2

**Types TPSS, THSS Long-time, Short-time
 and Instantaneous Time-current Curves**

(Curves apply at 50/60 Hertz and from -20C to +55C breaker ambient)

GES-6186A

Adjustments

Long-time Delay Unit: Continuous current settings are 50, 60, 70, 80, 90 and 100% of sensor rating. Time-delay bands are maximum, intermediate and minimum.
Short-time Delay unit: Pick-up current settings are 2X, 2.5X, 3X, 4X, 6X and 8X multiples of long-time unit setting. Time-delay bands are maximum, intermediate and minimum.
Instantaneous Unit: Pick-up current settings are 3X, 4X, 5X, 6X, 8X and 10X multiples of long time unit setting.
Instantaneous Over Ride: Set of 15X sensor ampere rating when the adjustable instantaneous unit is omitted.