


MULTIPLES OF AMPERE SETTING (CONTINUOUS)

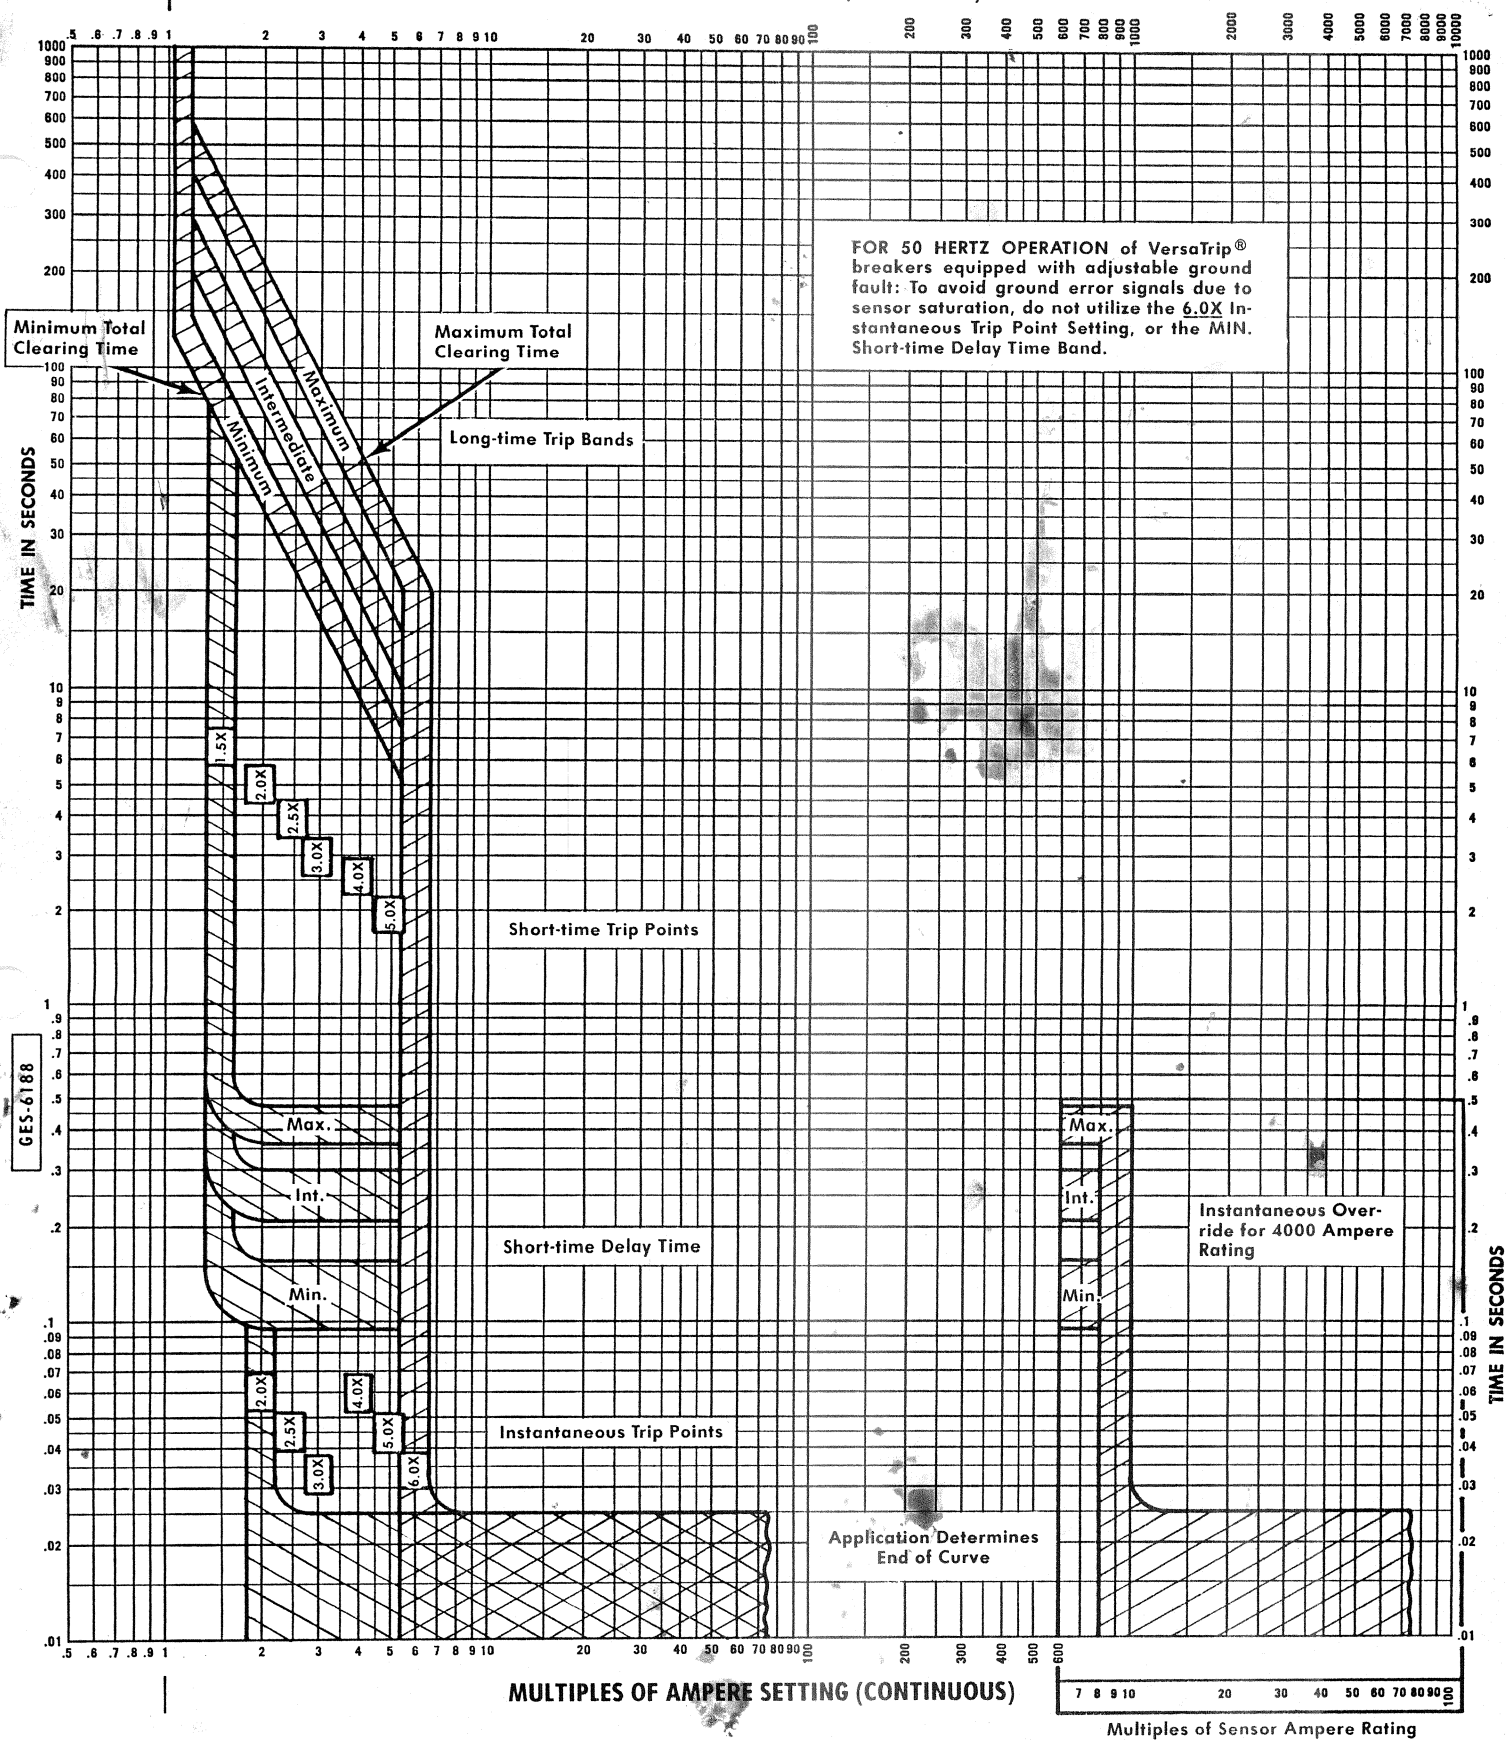

MULTIPLES OF AMPERE SETTING (CONTINUOUS)

Multiples of Sensor Ampere Rating

GENERAL ELECTRIC

Sensor Rating
4000 amperes

Voltage Rating
600 volts ac

Frequency Rating
50/60 Hertz

INSULATED CASE CIRCUIT BREAKER
POWER BREAK®

Solid State
With **VersaTrip®**
MOD2

Types TPSS, THSS Long-time, Short-time
and Instantaneous Time-current Curves

(Curves apply at 50/60 Hertz and from -20C to +55C breaker ambient)

GES-6188

Adjustments

Long-time Delay Unit: Continuous current settings are 50, 60, 70, 80, 90 and 100% of sensor rating. Time-delay bands are maximum, intermediate and minimum.
Short-time Delay Unit: Pick-up settings are 1.5X, 2.0X, 2.5X, 3.0X, 4.0X and 5.0X multiples of long-time unit setting. Time-delay bands are maximum, intermediate and minimum.
Instantaneous Unit: Pick-up current settings are 2X, 2.5X, 3.0X, 4.0X, 5.0X and 6.0X multiples of long-time unit setting.
Instantaneous Over Ride: Set at 9X sensor ampere rating when the adjustable instantaneous unit is omitted.